



Lectura **Contador**




Fotón Power, S.L.

105,8 KWp

581 KWh

sábado, 8 de marzo de 2014

Hora	Activa Exportada	Activa Importada	Reactiva C. Importada	Reactiva c. Exportada	Reactiva I. Exportada	Reactiva. I. Importada	Cualificadores
01:00	0	0	0	0	1	0	
02:00	0	0	0	0	2	0	
03:00	0	0	0	0	1	0	
04:00	0	0	0	0	1	0	
05:00	0	0	0	0	1	0	
06:00	0	0	0	0	2	0	
07:00	0	0	0	0	1	0	
08:00	0	0	0	0	1	0	
09:00	3	0	0	0	1	0	
10:00	15	0	0	0	1	0	
11:00	39	0	0	0	0	0	
12:00	59	0	0	2	0	0	
13:00	73	0	0	3	0	0	
14:00	79	0	0	4	0	0	
15:00	82	0	0	4	0	0	
16:00	80	0	0	4	0	0	
17:00	70	0	0	3	0	0	
18:00	53	0	0	1	0	0	
19:00	27	0	0	0	1	0	
20:00	0	0	0	0	1	1	
21:00	0	0	0	0	1	0	
22:00	0	0	0	0	2	0	
23:00	0	0	0	0	1	0	
00:00	1	0	0	0	1	0	
581	0	0	21	19	1		

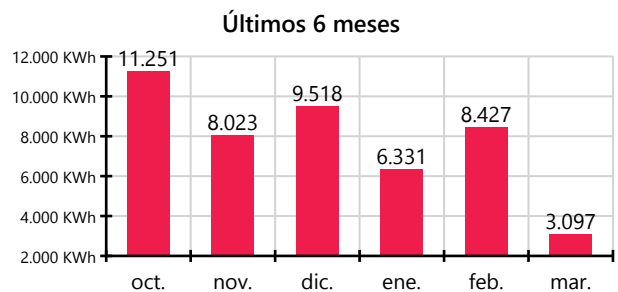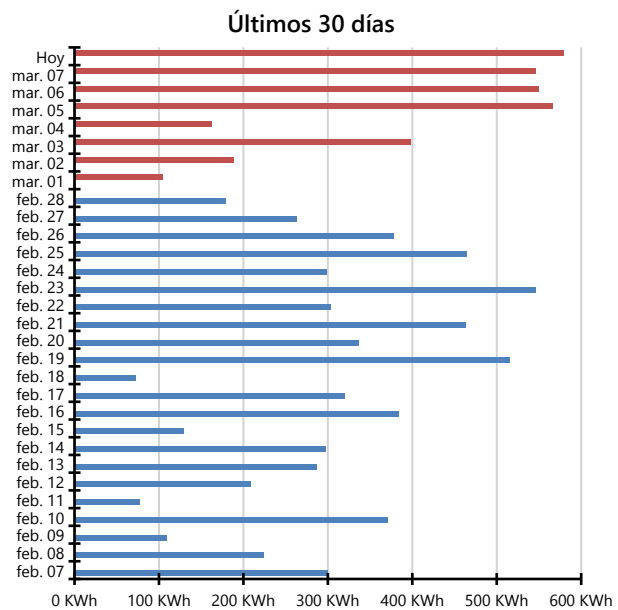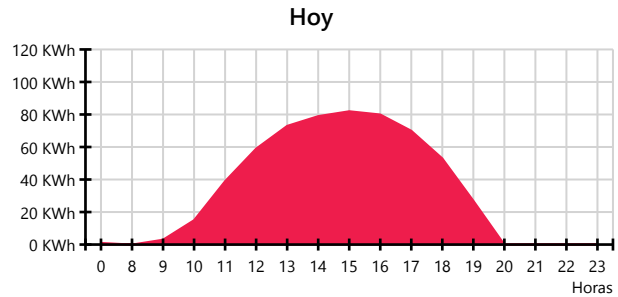

Leyenda de cualificadores

[IV] = Lectura no válida
 [CA] = Contador sincronizado
 [CY] = Desbordamiento del dato

[VH] = Verificación horaria
 [MP] = Modificación de parámetros

[INT] = Se produjo un intrusismo
 [AL] = Periodo incompleto por fallo de alimentación

